

GOVERNMENT OF ANDHRA PRADESH
A.P. STATE DISASTER RESPONSE AND FIRE SERVICES DEPARTMENT

From:
The Director General,
State Disaster Response & Fire Services,
Andhra Pradesh, Vijayawada.

To:
The District Educational Officer,
Krishna District.

Rc.No.6463/MSB/ER/KRI/2020, Dated.17-12-2020. - 2026

Sir,

Sub:- A.P.STATE DISASTER RESPONSE & FIRE SERVICE DEPARTMENT MSB Section-Eastern Region-Issuance of No Objection Certificate for Occupancy to the Existing Multi Storied Building of M/s Atkinson Senior Secondary School, D.No. 12-11-57, NTS No.517, Assmt No.1073027295, MPL Ward No.12, Rev Ward No.5, Block No.8, at Raja Rangayy Apparao Street, Vijayawada-1, Krishna District -Regarding.

- Ref:-
1. Application of M/s. Atkinson Senior Secondary School, D.No. 12-11-57, NTS No.517, Assmt No.1073027295, MPL Ward No.12, Rev Ward No.5, Block No.8, at Raja Rangayy Apparao Street, Vijayawada-1, Krishna District.
 2. This Office Memo Rc. No. 594/MSB/ER/KRI/2020, Dated.31-01-2020.
 3. MSB Inspection Committee Report Rc. No. 162/ER/KRI/2020, Dated. 03-03-2020.
 4. This office Rc.No.594/MSB/ER/KRI/2020, Dt:27-10-2020-Deficiencies communicated to the Management.
 5. Application of M/s. Atkinson Senior Secondary School, D.No. 12-11-57, NTS No.517, Assmt No.1073027295, MPL Ward No.12, Rev Ward No.5, Block No.8, at Raja Rangayy Apparao Street, Vijayawada-1, Krishna District.

<<O>>

The Management has requested for issuance of No Objection Certificate for Occupancy to the existing Building of Atkinson Senior Secondary School, D.No. 12-11-57, NTS No.517, Assmt No.1073027295, MPL Ward No.12, Rev Ward No.5, Block No.8, at Raja Rangayy Apparao Street, Vijayawada-1, Krishna District in the reference 5th cited.

2) The Management has not obtained Provisional No Objection Certificate; the deficiencies communicated to the above Management vide reference 2nd cited and now applied for No Objection Certificate for Occupancy.

3) The Inspection Committee has inspected the premises of Atkinson Senior Secondary School, D.No. 12-11-57, NTS No.517, Assmt No.1073027295, MPL Ward No.12, Rev Ward No.5, Block No.8, at Raja Rangayy Apparao Street, Vijayawada-1, Krishna District on 03-03-2020 and based on the Self Certification report of the Management, Atkinson Senior Secondary School, D.No. 12-11-57, NTS No.517, Assmt No.1073027295, MPL Ward No.12, Rev Ward No.5, Block No.8, at Raja Rangayy Apparao Street, Vijayawada-1, Krishna District vide reference 5th cited. The existing building details are shown below.

4) The Management has constructed a Multi Storied Building with following (05) Blocks.

Sl.No.	Block Name	Height of the Building in Mtrs.,	No. of Floors	Built up area in Sq.Mtrs.,
1	Block-I	09.50	Ground + (02) Upper floors	1450.17
2	Block-II	15.00	Stilt + (03) Upper floors	1585.96
3	Block-III	13.96	Ground + (03) Upper floors	1676.24
4	Block-IV	20.60	Stilt + (05) Upper floors	3594.27
5	Block-V	10.16	Ground + (02) Upper floors	1338.33
Total:				9644.97

Contd..2p

:: 2 ::
BLOCK - I

5) **Particulars of the building:**

a) Address of the Building	:	M/s. Atkinson Senior Secondary School, D.No.12-11-57, NTS No.517, Assmt No.1073027295, MPL Ward No.12, Rev Ward No.5 Block No.8 at Raja Rangayya Apparao Street, Vijayawada, Krishna District.
b) Height of the building	:	09.50 meters
c) No. of Floors	:	Ground + (02) Upper Floors.
d) Type of Occupancy	:	Educational (B1)

6) The Builder has provided the following Means of Escape.

Sl. No.	Details of Means of Escape	Minimum width required		Provided	
		No	Width	Nos.	Width in meters
1	Internal Staircase	1No	01.50 Mtrs.,	01	01.40 (from Ground to 2 nd Floor only)
2	External Staircase	1No	01.50 Mtrs.,	Nil	Nil

7) The details of Occupant Load per Unit and Exit Width required and provided is furnished as below:

Sl. No.	Floor	Built-up area in Sq.Mtrs.,	Type of Occupancy	No. of Occupants	Means of escape Required in Mtrs.,	Provided In Mtrs.,
1	Ground Floor	483.39	Educational	120	Required 0.78 Mtrs Width of Doors	Provided sufficient No.of Doors
2	1 st Floor	483.39	Educational	120	01.20	01.40
3	2 nd Floor	483.39	Educational	120	01.20	01.40
	Total	1450.17				

8) The Management has provided the following Fire Fighting Equipment keeping in view of practicality, maintenance and resilience.

Sl No	Fire Fighting Equipment	Prescribed	Provided	Deficit
1	Fire Extinguishers	ABC type	15 Nos.	Nil
2	Underground parking /Cellar / Basement	Temperature Sensors connected "Hooter" and that can give alerts through cell phone	Not applicable	Not applicable
3	Manual Call point	One number per floor	03 Nos.	Nil
4	Under Ground Static Water Tank (or) Terrace Water Tank	5,000 Ltrs (minimum)	10,000 Ltrs.	Nil
5	2 HP (Pump + Electrical Motors connected) @ one per floor connected to normal plumbing system instead of down comer/special pipes.	One per each floor (Total 3 floors)	01 Nos.	02 Nos.
6	5 HP (Mobile Pump + Petrol Engine on wheels by connecting at Ground floor sump)	One number	Not applicable	Not applicable

Contd...3p

9) The Management has provided the following Electrical Safety system.

(i) Miniature Circuit Breakers, MCBs	:	Provided
(ii) No overloading of Power sockets	:	Yes
(iii) 10 years old wiring to be changed specially wherever A/c is there ?	:	Provided
(iv) LED Lights in closed Rooms, Corridors, Staircases connected to Inverter (Battery)	:	Provided
(v) Grounding/Earthing is provided	:	Provided
(vi) Lightning Conductor is provided	:	Provided
(vii) The above shall be certified by authorized Electrical Contractor/Supervisor.	:	Yes

BLOCK - II

10) Particulars of the building:

a) Address of the Building	:	M/s. Atkinson Senior Secondary School, D.No.12-11-57, NTS No.517, Assmt No.1073027295, MPL Ward No.12, Rev Ward No.5 Block No.8 at Raja Rangayya Apparao Street, Vijayawada, Krishna District.
b) Height of the building	:	15.00 meters
c) No. of Floors	:	Stilt + (03) Upper Floors.
d) Type of Occupancy	:	Educational (B1)

11) The Builder has provided the following Means of Escape.

Sl. No.	Details of Means of Escape	Minimum width required		Provided In meters	
		No.	Width	Nos.	Width in meters
1.	Internal Staircase	01	01.50 Mtrs.,	02	02 Nos X 01.20 = 02.40
2.	External staircase	01	01.50 Mtrs.,	Nil	Nil

Note: Provided 01 No. of Horizontal exits with width of each 01.80 Mtrs from Block-2 to Block-3 (i.e. 1st floor to 1st floor & 2nd floor to 2nd floor).

12) The details of Occupant Load per Unit and Exit Width required and provided is furnished as below:

Sl. No.	Floor	Built-up area in Sq.Mtrs.,	Type of Occupancy	No. of Occupants	Means of escape Required in Mtrs.,	Provided In Mtrs.,
1	Stilt	396.49	Educational	99	Required 0.64 Mtrs Width of Doors	Provided sufficient No.of Doors
2	1 st Floor	396.49	Educational	99	0.99	02.40
3	2 nd Floor	396.49	Educational	99	0.99	02.40
4	3 rd Floor	396.49	Educational	99	0.99	02.40
	Total	1585.96				

13) The Management has provided the following Fire Fighting Equipment keeping in view of practicality, maintenance and resilience.

Sl No	Fire Fighting Equipment	Prescribed	Provided	Deficit
1	Fire Extinguishers	ABC type	16 Nos.	Nil
2	Underground parking /Cellar / Basement	Temperature Sensors connected "Hooter" and that can give alerts through cell phone	Not applicable	Not applicable
3	Manual Call point	One number per floor	08 Nos.	Nil

Sl No	Fire Fighting Equipment	Prescribed	Provided	Deficit
4	Under Ground Static Water Tank (or) Terrace Water Tank	5,000 Ltrs (minimum)	10,000 Ltrs.	Nil
5	2 HP (Pump + Electrical Motors connected) @ one per floor connected to normal plumbing system instead of down comer/special pipes.	One per each floor (Total 4 floors)	01 Nos.	03 Nos.
6	5 HP (Mobile Pump + Petrol Engine on wheels by connecting at Ground floor sump)	One number	Not applicable	Not applicable

14) The Management has provided the following Electrical Safety system.

(i) Miniature Circuit Breakers, MCBs	:	Provided
(ii) No overloading of Power sockets	:	Yes
(iii) 10 years old wiring to be changed specially wherever A/c is there ?	:	Provided
(iv) LED Lights in closed Rooms, Corridors, Staircases connected to Inverter (Battery)	:	Provided
(v) Grounding/Earthing is provided	:	Provided
(vi) Lightning Conductor is provided	:	Provided
(vii) The above shall be certified by authorized Electrical Contractor/Supervisor.	:	Yes

BLOCK - III

15) Particulars of the building:

a) Address of the Building	:	M/s. Atkinson Senior Secondary School, D.No.12-11-57, NTS No.517, Assmt No.1073027295, MPL Ward No.12, Rev Ward No.5 Block No.8 at Raja Rangayya Apparao Street, Vijayawada, Krishna District.
b) Height of the building	:	13.96 meters
c) No. of Floors	:	Ground + (03) Upper Floors.
d) Type of Occupancy	:	Educational (B1)

16) The Builder has provided the following Means of Escape.

Sl. No.	Details of Means of Escape	Minimum width required		Provided in meters	
		No	Width	Nos.	Width in meters
1.	Internal Staircase	01	01.50 Mtrs.,	02	01.45 +01.50
2.	External staircase	01	01.50 Mtrs.,	Nil	Nil

Note: Provided 01 No. of Horizontal exits with width of each 01.80 Mtrs from Block-2 to Block-3 (i.e. 1st floor to 1st floor & 2nd floor to 2nd floor).

17) The details of Occupant Load per Unit and Exit Width required and provided is furnished as below:

Sl. No.	Floor	Built-up area in Sq.Mtrs.,	Type of Occupancy	No. of Occupants	Means of escape Required in Mtrs.,	Provided In Mtrs.,
1	Ground	419.06	Educational	105	Required 0.68 Mtrs Width of Doors	Provided sufficient No.of Doors

Sl. No.	Floor	Built-up area in Sq.Mtrs.,	Type of Occupancy	No. of Occupants	Means of escape Required in Mtrs.,	Provided In Mtrs.,
2	1 st Floor	419.06	Educational	105	01.05	02.95
3	2 nd Floor	419.06	Educational	105	01.05	02.95
4	3 rd Floor	419.06	Educational	105	01.05	02.95
	Total	1676.24				

18) The Management has provided the following Fire Fighting Equipment keeping in view of practicality, maintenance and resilience.

Sl No	Fire Fighting Equipment	Prescribed	Provided	Deficit
1	Fire Extinguishers	ABC type	17 Nos.	Nil
2	Underground parking /Cellar / Basement	Temperature Sensors connected "Hooter" and that can give alerts through cell phone	Not applicable	Not applicable
3	Manual Call point	One number per floor	08 Nos.	Nil
4	Under Ground Static Water Tank (or) Terrace Water Tank	5,000 Ltrs (minimum)	10,000 Ltrs.	Nil
5	2 HP (Pump + Electrical Motors connected) @ one per floor connected to normal plumbing system instead of down comer/special pipes.	One per each floor (Total 4 floors)	01 Nos.	03 Nos.
6	5 HP (Mobile Pump + Petrol Engine on wheels by connecting at Ground floor sump)	One number	Not applicable	Not applicable

19) The Management has provided the following Electrical Safety system.

(i) Miniature Circuit Breakers, MCBs	:	Provided
(ii) No overloading of Power sockets	:	Yes
(iii) 10 years old wiring to be changed specially wherever A/c is there ?	:	Provided
(iv) LED Lights in closed Rooms, Corridors, Staircases connected to Inverter (Battery)	:	Provided
(v) Grounding/Earthing is provided	:	Provided
(vi) Lightning Conductor is provided	:	Provided
(vii) The above shall be certified by authorized Electrical Contractor/Supervisor.	:	Yes

BLOCK - IV

20) **Particulars of the building:**

a) Address of the Building	:	M/s. Atkinson Senior Secondary School, D.No.12-11-57, NTS No.517, Assmt No.1073027295, MPL Ward No.12, Rev Ward No.5 Block No.8 at Raja Rangayya Apparao Street, Vijayawada, Krishna District.
b) Height of the building	:	20.60 meters
c) No. of Floors	:	Stilt + (05) Upper Floors.
d) Type of Occupancy	:	Educational (B1)

21) The builder has provided the following Means of Escape.

Sl. No.	Details of Means of Escape	Minimum width required		Provided in meters	
		No	Width	Nos.	Width in meters
1.	Internal Staircase	01	01.50 Mtrs.,	02	01.50+01.95
2.	External Staircase	01	01.50 Mtrs.,	01	01.50
	Total	02		03	04.95

22) The details of Occupant Load per Unit and Exit Width required and provided is furnished as below:

Sl. No.	Floor	Built-up area in Sq.Mtrs.,	Type of Occupancy	No. of Occupants	Means of escape Required in Mtrs.,	Provided in Mtrs.,
1	Stilt	585.17	Parking	--	--	--
2	1 st Floor	601.82	Educational	150	01.50	04.95
3	2 nd Floor	601.82	Educational	150	01.50	04.95
4	3 rd Floor	601.82	Educational	150	01.50	04.95
5	4 th Floor	601.82	Educational	150	01.50	04.95
6	5 th Floor	601.82	Educational	150	01.50	04.95
	Total	3594.27				

23) The Management has provided the following Fire Fighting Equipment keeping in view of practicality, maintenance and resilience.

Sl No	Fire Fighting Equipment	Prescribed	Provided	Deficit
1	Fire Extinguishers	ABC type	36 Nos.	Nil
2	Underground parking /Cellar / Basement	Temperature Sensors connected "Hooter" and that can give alerts through cell phone	Not applicable	Not applicable
3	Manual Call point	One number per floor	12 Nos.	Nil
4	Under Ground Static Water Tank (or) Terrace Water Tank	5,000 Ltrs (minimum)	15,000 Ltrs.	Nil
5	2 HP (Pump + Electrical Motors connected) @ one per floor connected to normal plumbing system instead of down comer/special pipes.	One per each floor (Total 6 floors)	01 No.	04 Nos.
6	5 HP (Mobile Pump + Petrol Engine on wheels by connecting at Ground floor sump)	One number at Ground floor	required	1 No.

24) The Management has provided the following Electrical Safety system.

(i) Miniature Circuit Breakers, MCBs	:	Provided
(ii) No overloading of Power sockets	:	Yes
(iii) 10 years old wiring to be changed specially wherever A/c is there ?	:	Provided
(iv) LED Lights in closed Rooms, Corridors, Staircases connected to Inverter (Battery)	:	Provided
(v) Grounding/Earthing is provided	:	Provided
(vi) Lightening Conductor is provided	:	Provided
(vii) The above shall be certified by authorized Electrical Contractor/Supervisor.	:	Yes

BLOCK - V

25) Particulars of the building:

a) Address of the Building	:	M/s. Atkinson Senior Secondary School, D.No.12-11-57, NTS No.517, Assmt No.1073027295, MPL Ward No.12, Rev Ward No.5 Block No.8 at Raja Rangayya Apparao Street, Vijayawada, Krishna District.
b) Height of the building	:	10.16 meters
c) No. of Floors	:	Ground + (02) Upper Floors.
d) Type of Occupancy	:	Educational (B1)

26) The Builder has provided the following Means of Escape (Internal Staircases).

Sl. No.	Details of Means of Escape	Minimum width required		Provided in meters	
		No	Width	Nos.	Width in meters
1.	Internal Staircase	01	01.50 Mtrs.,	02	01.15 +01.25
2.	External Staircase	01	01.50 Mtrs.,	Nil	Nil

27) The details of Occupant Load per Unit and Exit Width required and provided is furnished as below:

Sl. No.	Floor	Built-up area in Sq.Mtrs.,	Type of Occupancy	No. of Occupants	Means of escape Required in Mtrs.,	Provided in Mtrs.,
1	Ground	446.11	Educational	113	Required 0.73 Mtrs Width of Doors	Provided sufficient No.of Doors
2	1st Floor	446.11	Educational	113	01.13	02.35
3	2nd Floor	446.11	Educational	113	01.13	02.35
	Total	1338.33				

28) The Management has provided the following Fire Fighting Equipment keeping in view of practicality, maintenance and resilience.

Sl No	Fire Fighting Equipment	Prescribed	Provided	Deficit
1	Fire Extinguishers	ABC type	15 Nos.	Nil
2	Underground parking /Cellar / Basement	Temperature Sensors connected "Hooter" and that can give alerts through cell phone	Not applicable	Not applicable
3	Manual Call point	One number per floor	02 Nos.	Nil
4	Under Ground Static Water Tank (or) Terrace Water Tank	5,000 Ltrs (minimum)	10,000 Ltrs.	Nil
5	2 HP (Pump + Electrical Motors connected) @ one per floor connected to normal plumbing system instead of down comer/special pipes.	One per each floor (Total 3 floors)	01 No.	02 Nos.
6	5 HP (Mobile Pump + Petrol Engine on wheels by connecting at Ground floor sump)	One number	Not applicable	Not applicable

29) The Management has provided the following Electrical Safety system.

	:	Provided
(i) Miniature Circuit Breakers, MCBs	:	Yes
(ii) No overloading of Power sockets	:	Provided
(iii) 10 years old wiring to be changed specially wherever A/c is there ?	:	Provided
(iv) LED Lights in closed Rooms, Corridors, Staircases connected to Inverter (Battery)	:	Provided
(v) Grounding/Earthing is provided	:	Provided
(vi) Lightning Conductor is provided	:	Yes
(vii) The above shall be certified by authorized Electrical Contractor/Supervisor.	:	

30) The inspection committee has tested the provided fire safety systems and found in working condition.

31) The Management is responsible all risks involved in case of Fire Accident.

32) In view of the above and taking into the consideration of larger public interest and in context of the COVID-19 Pandemic Crisis across the country due to an acute shortage of beds to the patients and also based on the inspection committee report, the No Objection Certificate for Occupancy is issued to the existing building of M/s Atkinson Senior Secondary School, D.No. 12-11-57, NTS No.517, Assmt No.1073027295, MPL Ward No.12, Rev Ward No.5, Block No.8, at Raja Rangay Apparao Street, Vijayawada-1, Krishna District for a period of (05) years, subject to the appropriate building permission from Municipal Corporation and the Fire safety systems mentioned above shall be provided within one year by the Management and report submit to this office.

33) This No Objection Certificate is issued, subject to the outcome of O.As/W.Ps etc., if any, before Courts etc.,

34) It is informed that, the Management of M/s Atkinson Senior Secondary School, D.No. 12-11-57, NTS No.517, Assmt No.1073027295, MPL Ward No.12, Rev Ward No.5, Block No.8, at Raja Rangay Apparao Street, Vijayawada-1, Krishna District is requested to maintain the following conditions compulsorily for safety purpose.

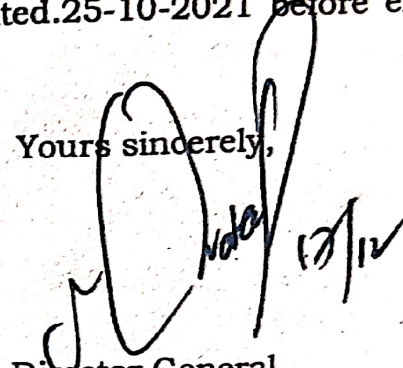
As Builder	As occupant	As Security Personnel
All the fire protection arrangements shall be maintained in good condition at all times.	All the escape/exit routes shall not be kept locked/blocked or encroached	All the occupants must train in correct method of operation of the fire fighting system installed.
Any loss of life or property due to non-functioning of fire safety measures and other installations shall be the responsibility of the management.	All occupants shall be trained to operate the fire safety equipments during emergency.	Mock drills should be conducted once in 3 months for initial two years. Thereafter, once in every 6 months.
Addition / alteration, if any in the building may be verified by building authority.	Mock drills should be conducted once in 3 months for initial two years. Thereafter, once in every 6 months.	All security personnel shall be trained to operate the fire safety equipments during emergency.
This No objection Certificate for occupancy is issued from fire safety point of view.	Raise the alarm if the fire cannot be controlled; Evacuate the area completely at once with nearest safe exit.	Attack the fire using available fire equipment only if you feel capable of controlling. If not, take all steps to isolate the area by closing doors and windows.

Fire

:: 9 ::

15) This No Objection Certificate for Occupancy is valid for a period of Five years only from the date of issue of this letter subject to the compliance of above Fire and Electrical Safety Measures. The owner/ Occupier/ Builder/ Management concerned of the building shall submit self declaration/ Certification with regard to working condition of fire safety measures every year in the prescribed format and submit/upload the photographs of the Mock drills conducted in the premises. It is the responsibility of the builder to apply for Renewal of No Objection Certificate for Occupancy, duly remitting the User Charges as per G.O.Ms.No.90, Home (Prisons & Fire) Department, dated.13-08-2021 and G.O.Ms.No.120, Home (Prisons & Fire) Department, dated.25-10-2021 before expiry of this No Objection Certificate.

Yours sincerely,




Director General,
State Disaster Response and Fire Services,
Andhra Pradesh, Vijayawada.

Copy to the Management of M/s Atkinson Senior Secondary School, D.No. 12-11-57,
NTS No.517, Assmt No.1073027295, MPL Ward No.12, Rev Ward No.5, Block No.8, at
Raja Rangayy Apparao Street, Vijayawada-1, Krishna District.
Copy to the Regional Fire Officer, Eastern Region, Vijayawada.
Copy to District Fire Officer, Krishna District.

Note: In case of any emergency call to 101 or State Fire Control Room-9100108101.


PRINCIPAL
ATKINSON SR. SEC. SCHOOL
VIJAYAWADA-520 001.


CORRESPONDENT
ATKINSON Sr. Sec. SCHOOL
CONVENT STREET,
VIJAYAWADA-520 001

**GOVERNMENT OF ANDHRA PRADESH
STATE DISASTER RESPONSE & FIRE SERVICES DEPARTMENT**

From :
The Director General,
State Disaster Response and Fire Services,
Andhra Pradesh, Vijayawada.

To :
The District Educational Officer,
Krishna District.

Rc.No. 6462/Non-HRB/ER/KRI/2021, Dt: 17.12.2021 - 22, 23, 24, 25
2026

Sir,

Sub: A.P. State Disaster Response and Fire Services Department-MSB Section-
Issuance of No Objection Certificate for Occupancy to Educational
Building of M/s Atkinson Nursery School, D.No. 12-11-22, NTS No.93,
Assmt No.1073027332, MPL Ward No. 12A, Rev Ward No.5, Block No.3 at
Raja Rangayy Apparao Street, Vijayawada-1, Krishna District -Regarding.

- Ref:-**
1. Application of Educational Building of M/s Atkinson Nursery School, D.No. 12-11-22, NTS No.93, Assmt No.1073027332, MPL Ward No. 12A, Rev Ward No.5, Block No.3 at Raja Rangayy Apparao Street, Vijayawada-1, Krishna District.
 2. Self certification of the Management.

The Management of M/s Atkinson Nursery School, D.No. 12-11-22, NTS No.93, Assmt No.1073027332, MPL Ward No. 12A, Rev Ward No.5, Block No.3 at Raja Rangayy Apparao Street, Vijayawada-1, Krishna District has requested to issue No Objection Certificate for Occupancy vide reference 1stcited.

2) The Management has submitted the self certification for Educational Building with Ground + (03) Upper floors with a height of 11.73 Mtrs., total built up area of 1802.20 Sq.Mtrs., without kitchen and without A/c and stated that, they have provided the following Fire Safety Measures:

Sl.No.	Name of the equipment	:	Fire Safety Measures	Available with Nos.	Deficit
1.	Staircases	:	1)Minimum (02) shall be Provided .If the Second stair case is not possible, provide slider or Tube lift with exhaust fan (connected outside to building) or German chute or horizontal connection between the neighborhood buildings.	02 Nos.	Nil
2.	Fire fighting equipment	:	2) Extinguishers (01 Extinguisher of ABC type for each class room)	12 Nos.	Nil
			3) Manually operated electronic fire alarm system	04 Nos..	Nil
			4) Water Tank 5,000 Ltrs.,	Available	Nil
			5) 2 HP Motor with triplex Pump Shall be connected to normal plumbing system at Each floor.	01 No.	03 Nos
			6) Display the following Nos. at Kitchen & other important areas (i) Fire Department number. (ii) Ambulance (iii) Police	Displayed	Nil
3.	Kindergarten class rooms	:	7) Shall be located on ground floor preferably.	Yes	Nil
4.	Class-I to IV	:	8) Shall be located either on ground or on first floor preferably.	First floor	Nil

Contd....2p

3) The Management has stated that, they have satisfied with the installations and maintenance of the fire safety equipment working condition in the above Educational building and also declared that no kitchen and A/c are provided in the premises and no additions or alterations have been made in the building affecting Fire Prevention and Fire Safety Measures including means of escape and that all exits and passages are free from any obstruction.

4) It is the responsibility of the Management to ensure the above Fire Safety Measures and maintain them in good working condition in the above Educational Building. The Management is responsible all risks involved in case of Fire Accidents

5) In view of the above and based on the self certification submitted by the Management and also taking into consideration of the larger public interest and in the context of the COVID-19 pandemic across the country, the No Objection Certificate for Occupancy is issued to the M/s Atkinson Nursery School, D.No. 12-11-22, NTS No.93, Assmt No.1073027332, MPL Ward No. 12A, Rev Ward No.5, Block No.3 at Raja Rangayy Apparao Street, Vijayawada-1, Krishna District **subject to the condition that management to provide deficit Fire safety system within (01) year and report compliance to this office without fail.**

6) The Management shall ensure the following conditions:

(i) The Management is responsible for all risks involved in case of Fire Accident.

(ii) This NOC is given based on the information, documents and drawings provided by the applicant. The applicant confirms that the information provided and the documents and drawings submitted are correct. Any deviation noticed will lead to cancellation of NOC without any notice.

(iii) The permission accorded does not confer any ownership rights. If it is found that the information furnished is false and fabricated, the permission will be revoked at any stage and the applicant will be liable for criminal prosecution as per IPC.

(iv) The Management shall ensure the following precautions strictly at all the times:

7) Maintain the following conditions compulsorily for safety point of view.

Sl. No.	As Builder	As occupant	As Security Personnel
1	All the fire protection arrangements shall be maintained in good condition.	All the escape/exit routes shall not be kept locked/blocked or encroached	All the occupants must know the correct method of operation of the fire fighting system installed.
2	Any loss of life or property due to non-functioning of fire safety measures and other installations shall be the responsibility of the management.	All occupants shall be trained to operate the fire safety equipment during emergency.	Mock drills should be conducted once in 3 months for initial two years. Thereafter, once in every 6 months.
3	Addition / alteration, if any in the building may be verified by building authority.	Mock drills should be conducted once in 3 months for initial two years. Thereafter, once in every 6 months.	All security personnel shall be trained to operate the fire safety equipment during emergency.

Fire Noc

:: 3 ::

Sl. No.	As Builder	As occupant	As Security Personnel
4	This No objection Certificate for occupancy issued only from fire safety point of view.	Raise the alarm if the fire cannot be controlled; Evacuate the area completely at once with nearest safe exit.	Attack the fire using available fire equipment only if you feel capable of controlling. If not, take all steps to isolate the area by closing doors and windows.

7) This No Objection Certificate for Occupancy is valid for a period of Five years only from the date of issue of this letter subject to the compliance of above Fire and Electrical Safety Measures. The owner/ Occupier/Builder/Management concerned of the building shall submit self declaration/ Certification with regard to working condition of fire safety measures every year in the prescribed format and submit/upload the photographs of the Mock drills conducted in the premises. It is the responsibility of the builder to apply for Renewal of No Objection Certificate for Occupancy, duly remitting the User Charges as per G.O.Ms.No.90, Home (Prisons & Fire) Department, dated.13-08-2021 and G.O.Ms.No.120, Home (Prisons & Fire) Department, dated.25-10-2021 before expiry of this No Objection Certificate.

8) This No Objection Certificate is issued, subject to the outcome of O.As/W.Ps etc., if any, before Courts etc.,

Yours Sincerely,

Director General,

State Disaster Response and Fire Services,
Andhra Pradesh, Vijayawada.


Copy to the Atkinson Nursery School, D.No. 12-11-22, Raja Rangayy Apparao Street, Vijayawada-1, Krishna District.

Copy to the Regional Fire Officer, Eastern Region, Vijayawada.

Copy to the District Fire Officer, Krishna District.

Note: In case of any emergency call to 101 or State Fire Control Room-9100108101.


PRINCIPAL
ATKINSON SR. SEC. SCHOOL
VIJAYAWADA-520 001


CORRESPONDENT
ATKINSON Sr. Sec. SCHOOL
CONVENT STREET,
VIJAYAWADA-520 001